



Fire detection and evacuation solutions that save lives.



Series 65

Product Guide

MAN3036-4

3 Heat Detector

3.1 Operating Principles:



The detector has a moulded self-extinguishing white polycarbonate case. Nickel plated stainless steel wiper contacts connect the detector to the base. Inside the case a printed circuit board holds the signal processing electronics. A pair of matched negative temperature co-efficient thermistors are mounted on the PCB in such a way that one thermistor is exposed to give good thermal contact with the surrounding air while the other thermistor is thermally insulated. Under stable conditions both thermistors are in thermal equilibrium and have the same value of resistance.

If air temperature increases rapidly the resistance of the exposed thermistor becomes less than that of the insulated thermistor. The ratio of the resistance of the thermistors is monitored electronically and an alarm is initiated if the ratio exceeds a factory preset level. This feature determines the 'rate of rise' response of the detector.

If air temperature increases slowly, no significant resistance difference develops between the thermistors, but at high temperatures a fixed value resistance connected in series with the insulated thermistor becomes significant. When the sum of the resistance of the insulated thermistor and the fixed resistor compared to the resistance of the exposed thermistor reaches a preset value, an alarm is initiated. The value of the fixed resistor is selected to set the detector into alarm state at a specified fixed temperature.

The detector signals an alarm state by switching an alarm latch on, increasing the current drawn from the supply from about 50 μ A to a maximum of about 75mA. This fall in the impedance of the detector is recognised by the control panel as an alarm signal. The alarm current also illuminates the detector integral LED. A remote indicator connected between the L1 IN terminal and the -R terminal will have a voltage equal to the supply voltage less 1 volt across it and so will illuminate.

To ensure correct operation of the detector the control panel must be arranged to supply a maximum of 33 volts DC and a minimum of 9 volts DC in normal operation. The supply may fall to 6 volts DC in alarm conditions if a supply current of at least 10mA is available at this voltage. To ensure effective illumination of the integral LED and any remote indicator, the supply to the detector should exceed 12 volts.

To restore the detector to quiescent condition, it is necessary to restore a normal temperature level and interrupt the electrical supply to the detector for a minimum of one second.

3.2 Product Codes

Product Description	SAI (AS7240-5)	LPCB (EN54-5)
Series 65 A1R (50°C) Heat Detector - Rate of Rise	4106-1004	55000-122AMP
Series 65 BR (65°C) Heat Detector - Rate of Rise	4106-1005	55000-127AMP
Series 65 CR (80°C) Heat Detector - Rate of Rise	4106-1006	55000-132AMP
Series 65 CS (80°C) Heat Detector - Static	4106-1007	55000-137AMP

3.3 Options:

1. Flashing LED: The integral LED flashes when the detector is in a quiescent state.
2. Magnetic test switch and Flashing LED: A magnetic test switch in the circuit of the detector can be magnetically activated from outside the case to initiate an alarm condition for test and commissioning purposes.

A flashing LED, as outlined above, is also included

3.4 Response Time:

European Standard EN54–5:2000 classifies heat detectors according to the alarm temperature and ambient operating temperature.

Each heat detector classification has a static response (changing to alarm at a preset temperature) and may also have a rate of rise response (changing to alarm at or above a preset increase of temperature). The heat detector classes available in Series 65 are A1R, BR, CR, CS. The suffix R indicates that the detector has been tested and approved as a 'rate-of-rise' detector. The suffix 'S' indicates that the detector has been tested and approved as a 'static' detector.

Class	Max Application Temperature °C	Max Static Response Temperature °C	Standard Item No
A1R	50	65	55000-122AMP
BR	65	85	55000-127AMP
CR	80	100	55000-132AMP
CS	80	100	55000-137AMP

Table 1 - Series 65 Heat Detector temperature and part numbers

4 Mounting Bases

4.1 Mounting Base:



All detectors in the Series 65 range fit into the Standard and Diode mounting bases. The bases are of 100mm diameter and have five terminals marked according to their function: Line 1 in, line 1 out, line 2 in and out, remote indicator negative, earth.

Detectors are polarity insensitive, so that identification of positive and negative lines is only required if a remote LED is fitted. An earth connection is not required for either safety or correct operation of detectors. The earth terminal is provided for tidy termination of earthed conductors or cable screens and to maintain earth continuity where necessary.

Bases have a wide interior diameter for ease of access to cables and terminals and there are two slots for fixing screws at a spacing of 51 to 69mm. Detectors fit into bases one way only and require clockwise rotation without push force to be plugged in. They can be locked into the base by a grub screw using a 1.5mm hexagonal driver.

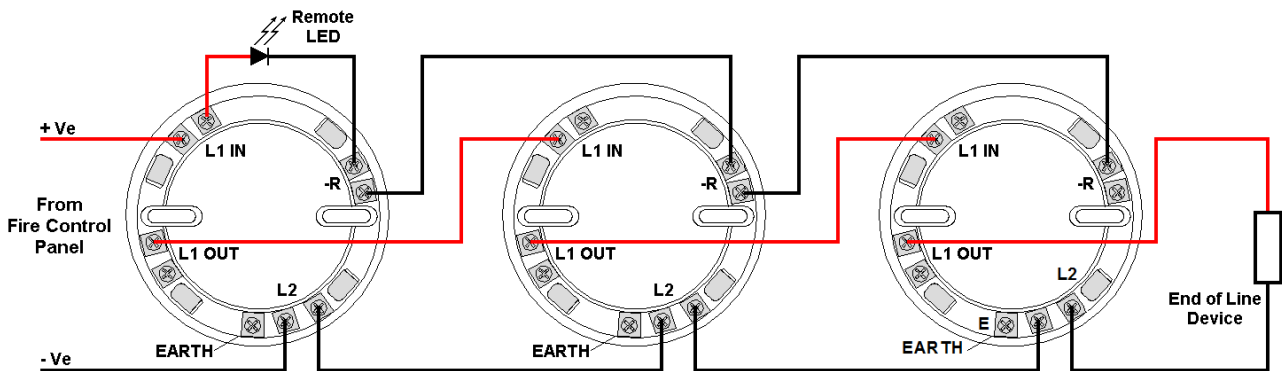


Figure 4 - Schematic wiring diagram of Series 65 monitored detector circuit with a common remote indicate

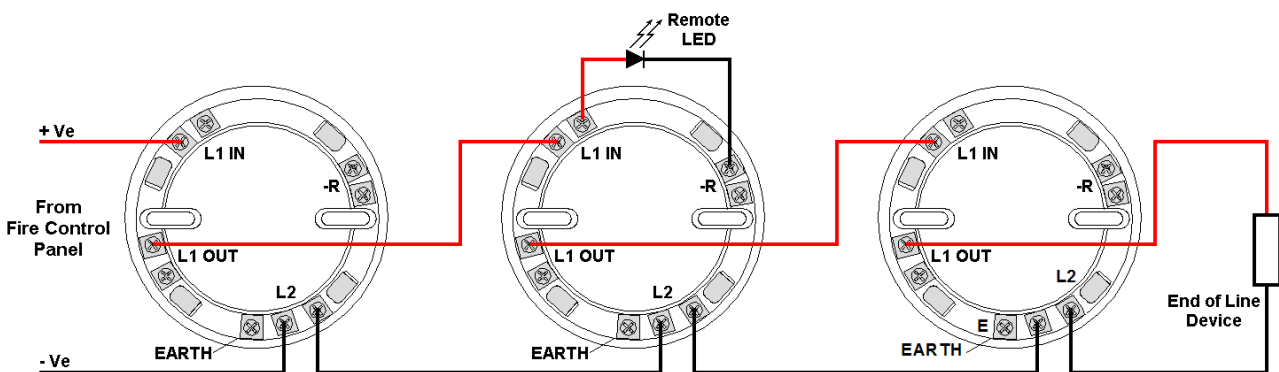


Figure 5 - Schematic wiring diagram of Series 65 monitored detector circuit

Product Description	SAI (AS7240)	LPCB (EN54)
Standard Base	4106-1008	45681-200AMP
Series 65 Diode Base	4106-1009	45681-201AMP

4.2 Relay Base:



Series 65 Relay Bases are primarily intended for use with control units using 4-wire detector supply and alarm initiating circuits. Where local codes allow, they may also be used in 2 and 4-wire circuits to provide volt-free control signals to an auxiliary system such as an automatic door closer.

The detector relay bases are not suitable for use in systems where it is specified or required that operation of the auxiliary system shall be fail-safe and must not be used with any other type of detector.

The Standard Series 65 Relay Base, 45681-245AMP, provides one set of volt-free, changeover (form C) contacts that change state when the detector signals an alarm.

Product Description	SAI (AS7240)	LPCB (EN54)
Series 65 Standard Relay Base	4106-1011	45681-245AMP

4.3 Sav-Wire Base:



The Series 65 Sav-Wire Base is designed to allow Series 65 detectors to be used in 'Sav-Wire' detection and alarm systems and can only be used in conjunction with a Sav-Wire compatible control panel. The base incorporates a circuit which detects the removal of a detector head. If a detector is removed from the base, the control panel will give a fault signal.

Product Description	SAI (AS7240)	LPCB (EN54)
Series 65 Sav-wire Base	N/A	45681-206AMP

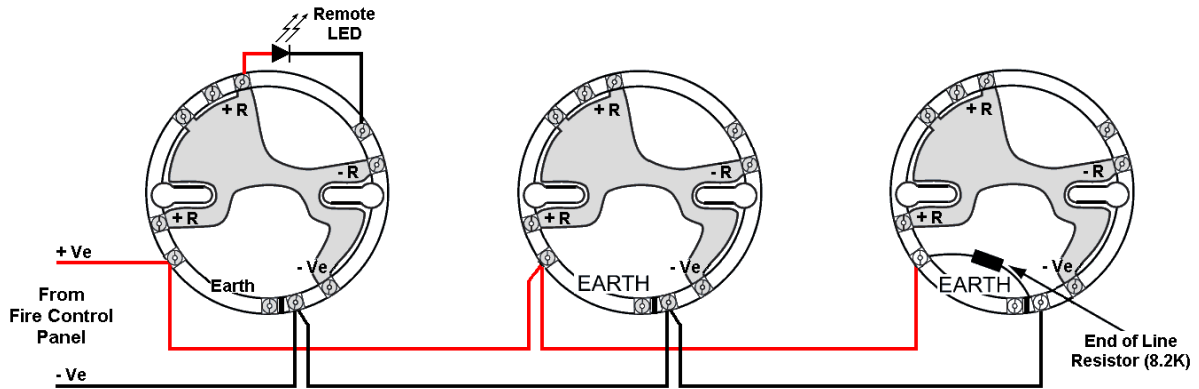


Figure 6 - Wiring diagram for Sav-Wire Base

4.4 Sounder Base:



The Series 65 Sounder Base is a high-efficiency conventional alarm sounder incorporating a base for the Series 65 range of detectors. The product offers 32 tones which are shown in the table below.

The sounder base can be secured to a conduit box, a sounder ceiling plate or surface mounted. Sounder Bases should be located to ensure correct operation of the detector in accordance with the detector manufacturer’s recommendations and local regulations or codes of practice.

Note: The sounder is classified as a Type A device according to EN54-3 and is suitable for indoor use only.

The sounder base is designed so that separate detector and sounder circuits can be connected. The sounder circuit is connected using the PCB mounted 4-way terminal block. The detector circuit is connected using the terminals marked L1IN, L1OUT and L2 around the rim of the base in the same way as a standard detector base. Two separate earth terminals are provided to allow the screen termination of earth conductors to maintain continuity between cables that contain an earth conductor. As this product is designed for use on conventional systems with separate detector and sounder circuits, the earths should not be connected together.

Product Description	SAI (AS7240)	LPCB (EN54)
Series 65 Sounder Base	N/A	45681-512AMP

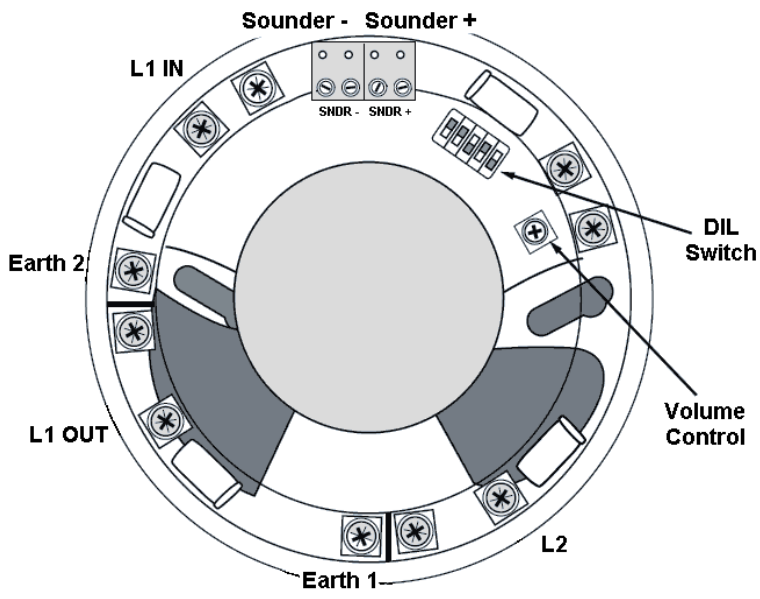


Figure 7 – Wiring Diagram of Series 65 Sounder Base

Tone	Tone Type	Tone description/application	DIL Switch 1_2_3_4_5	Sound level (dB(A) @ 1m)	Average Current (mA)
1		970Hz (BS5839-1:2002)	0-0-0-0-0	91	5
2		800/970Hz @ 2Hz (BS5839-1:2002)	0-0-0-0-1	91	5.2
3		800-970Hz @ 1Hz (BS5839-1:2002)	0-0-0-1-0	95	5
4		970Hz 1s OFF/1s ON (Apollo Fire Detectors Alert Tone, BS5839-1:2002)	0-0-0-1-1	91	3
5		970Hz, 0.5s/630Hz, 0.5s (Apollo Fire Detectors Evacuate Tone, BS5839-1:2002)	0-0-1-0-0	91	4.2
6		554Hz, 0.1s/440Hz, 0.04s (France - AFNOR NF S 32 001)	0-0-1-0-1	91	7
7		500-1200Hz, 3.5s/0.5s OFF (Netherlands - NEN 2575:2000)	0-0-1-1-0	93	4.2
8		420Hz 0.625s ON/0.625s OFF (Australia AS2220 Alert Tone)	0-0-1-1-1	84	2.7
9		500-1200Hz, 3.75s/0.25s OFF (Australia AS2220 Evacuation Tone)	0-1-0-0-0	90	2
10		550Hz/44Hz @ 0.5Hz	0-1-0-0-1	91	5.1
11		970Hz, 0.5s ON/0.5s OFF x 3/1.5s OFF (ISO 8201 Low tone)	0-1-0-1-0	91	2.6
12		2850Hz, 0.5s ON/0.5s OFF x 3/1.5s OFF (ISO 8201 High tone)	0-1-0-1-1	91	2.2
13		1200-500Hz @ 1Hz (DIN 33 404)	0-1-1-0-0	93	3.5
14		400Hz	0-1-1-0-1	85	4.2
15		550Hz, 0.7s/1000Hz, 0.33s ('SafeSound')	0-1-1-1-0	90	5.5
16		1500-2700Hz @ 3Hz (Vandal Alarm)	0-1-1-1-1	88	3.4
17		750Hz	1-0-0-0-0	86	4.8
18		2400Hz	1-0-0-0-1	86	4.8
19		750Hz 0.33s ON/0.51s OFF	1-0-0-1-0	86	3
20		750Hz 0.51s ON/0.33s OFF	1-0-0-1-1	86	4.3
21		800Hz 0.2s ON/0.2s OFF	1-0-1-0-0	86	2.6
22		510Hz, 0.5s/610Hz, 0.5s	1-0-1-0-1	91	5.8
23		550Hz, 0.33s/1000Hz, 0.7s	1-0-1-1-0	91	5.3
24		250-1200Hz @ 12Hz	1-0-1-1-1	87	3.8
25		500-1200Hz @ 0.33Hz	1-1-0-0-0	92	5.1
26		2500-2850Hz @ 7Hz	1-1-0-0-1	94	4.8
27		600-900Hz/0.9s	1-1-0-1-0	90	5.5
28		600-680Hz/0.9s	1-1-0-1-1	85	4.5
29		670-725Hz/0.9s	1-1-1-0-0	84	4.2
30		920-750Hz/0.9s	1-1-1-0-1	93	6.1
31		700-900Hz, 0.3s/0.6s OFF	1-1-1-1-0	90	4.6
32		900-760Hz, 0.6s/0.3s OFF	1-1-1-1-1	91	4

Table 2 – Series 65 Sounder Base Tone Table

5 MiniDisc Remote Indicator



Item No	Description
53832-070APO	Mini-Disc Remote Indicator

The Mini-Disc Remote Indicator is only 20mm high and 80mm in diameter. It comprises two parts – the base which is installed onto a wall or soffit and the lid which is fitted to the base with a bayonet lock. An anti-tamper screw in the lid locks the unit together.

Two pairs of keyholes are provided – one for 50mm and the other for 60mm fixing centres. The Mini-Disc Remote Indicator is polarity sensitive. Connect positive line to Terminal A or B and negative line to Terminal C.

6 Interchangeability

Any detector in the Series 65 range may be replaced with any other type in the range. If, for example, a smoke detector proved unsuitable for a particular application, it could simply be replaced with a heat detector. The bases are designed specifically for Series 65 detectors and will not accept devices from other detector manufacturers.

7 Control Panel Compatibility

Series 65 has been designed to be connected to any Ampac conventional fire control panel that will operate existing ranges of conventional detectors.

When engineering systems with Series 65, it should be borne in mind that the alarm impedance of a detector be considered as 420 Ohms in series with a 2 volt drop with LED open circuit.

8 EMC

All Series 65 detectors and relay bases comply with the requirements of the following EMC standards:

Generic Emission Standard EN 61000–6–3 Emission standards for residential, commercial and light industrial environments

Generic Emission Standard EN 61000–6–4 Emission standards for industrial environments

EN 50130–4: Alarm Systems Electromagnetic compatibility – product family standard: immunity requirements for components of fire, intruder and social alarm systems

EN 61000–4–2 Electrostatic discharge

EN 61000–4–3 Radiated immunity

EN 61000–4–4 Fast transient bursts

EN 61000–4–5 Surge immunity
A **Halma** company

EN 61000-4-6 Conducted immunity

All standard detectors and the relay bases have been assessed to the additional VdS EMC requirements shown below and have demonstrated full compliance: 30V/m with 80% Am sine and 100% pulse modulation depth over the frequency ranges 415 to 467MHz and 890 to 960 MHz.

Series 65 optical detector, part no 55000-317, and heat detector, part no 55000-122, have been declared to be compliant with the standard EN 50155: Railway applications : Electronic equipment used on rolling stock.

9 Approvals and Regulatory Compliance

The Series 65 range of detectors and relay bases is approved by a large number of certification bodies. These include approvals to EN54 : 2000 with LPCB, VdS, DIBT, BOSEC, and FG. Copies of certificates are available upon request.

Series 65 complies with the requirements of a number of European New Approach Directives such as the EMC Directive 89/336/ EEC and the Construction Products Directive 89/106/ EEC..

All Series 65 products will comply with the marking requirements of the WEEE Directive, 2002/96/EC.

10 Acknowledgements

All Series 65 detectors and products are manufactured for Ampac by Apollo Fire Detectors Ltd.

UNCONTROLLED DOCUMENT

NOTE: Due to AMPAC's commitment to continuous improvement specifications may change without notice.